

POUR SIDEWALK/RAMP SEPARATELY
FROM CURB & GUTTER

USE CLASS :A: CONCRETE ONLY
(TYPE V CEMENT, 4,000 PSI MIN.)

PLACE 4" COMPACTED CRUSHED
ROAD BASE GRAVEL UNDER
SIDEWALK AND RAMP


LENGTH "D" VARIES DEPENDING
UPON CURB RADIUS

REMOVE ANY EXISTING SIDEWALK
AND CURB & GUTTER REQUIRED
TO INSTALL NEW HANDICAP RAMP

RELOCATE STOP SIGNS, ETC. AS
DIRECTED BY THE ENGINEER

LOCATE CENTER OF RAMP AS
DIRECTED BY THE ENGINEER

PLACE 6" COMPACTED CRUSHED
ROAD BASE GRAVEL UNDER
CURB AND GUTTER

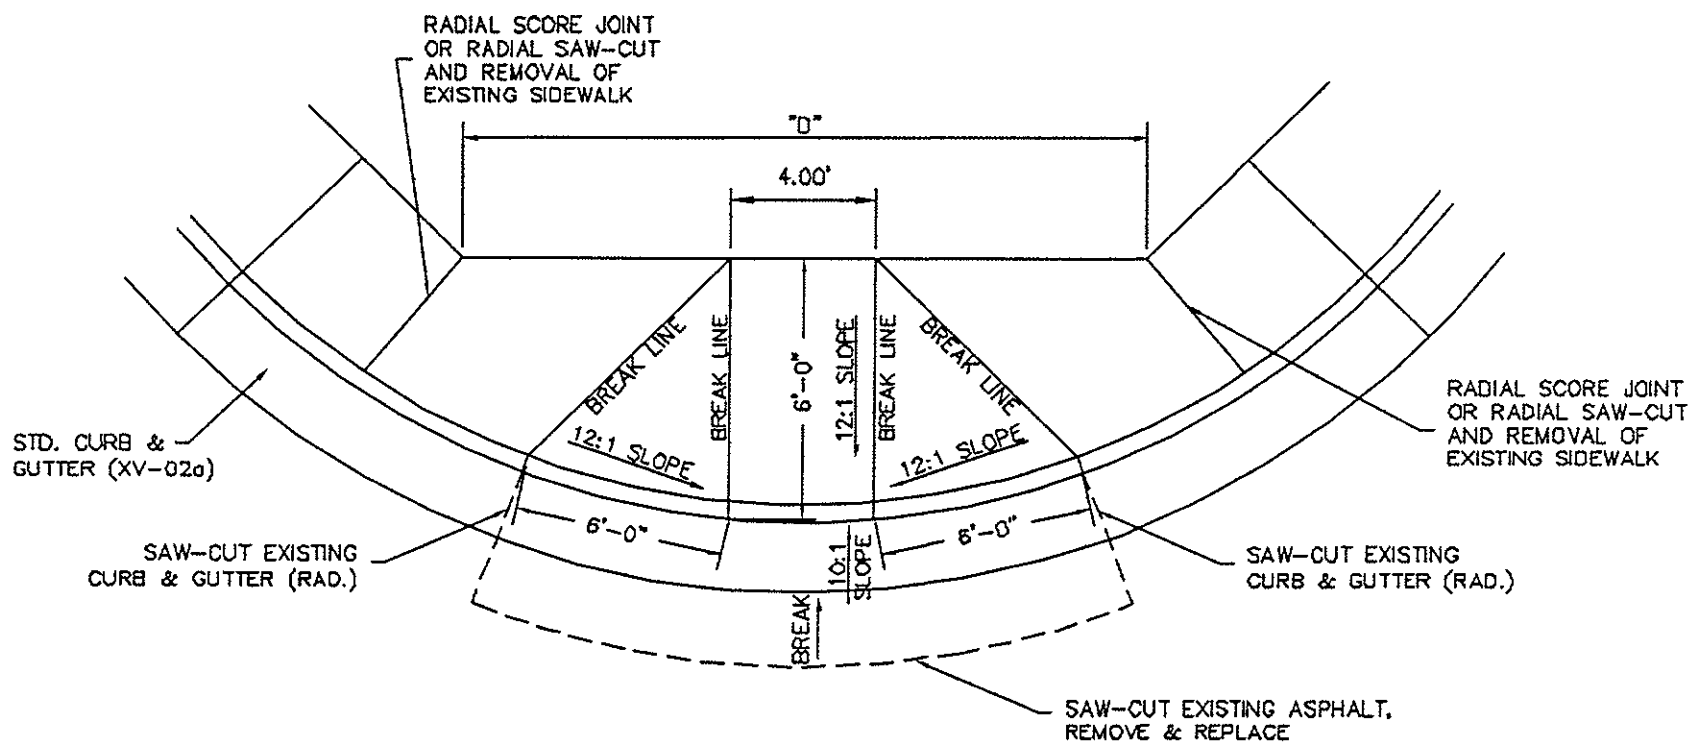

HANDICAP ACCESS RAMP

N.T.S.